MAY 2006

30 WELLS SAMPLED

27 WELLS - VINYL CHLORIDE NOT DETECTED

3 WELLS - VINYL CHLORIDE DETECTED AT OR BELOW HEALTH RISK LIMIT

0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT

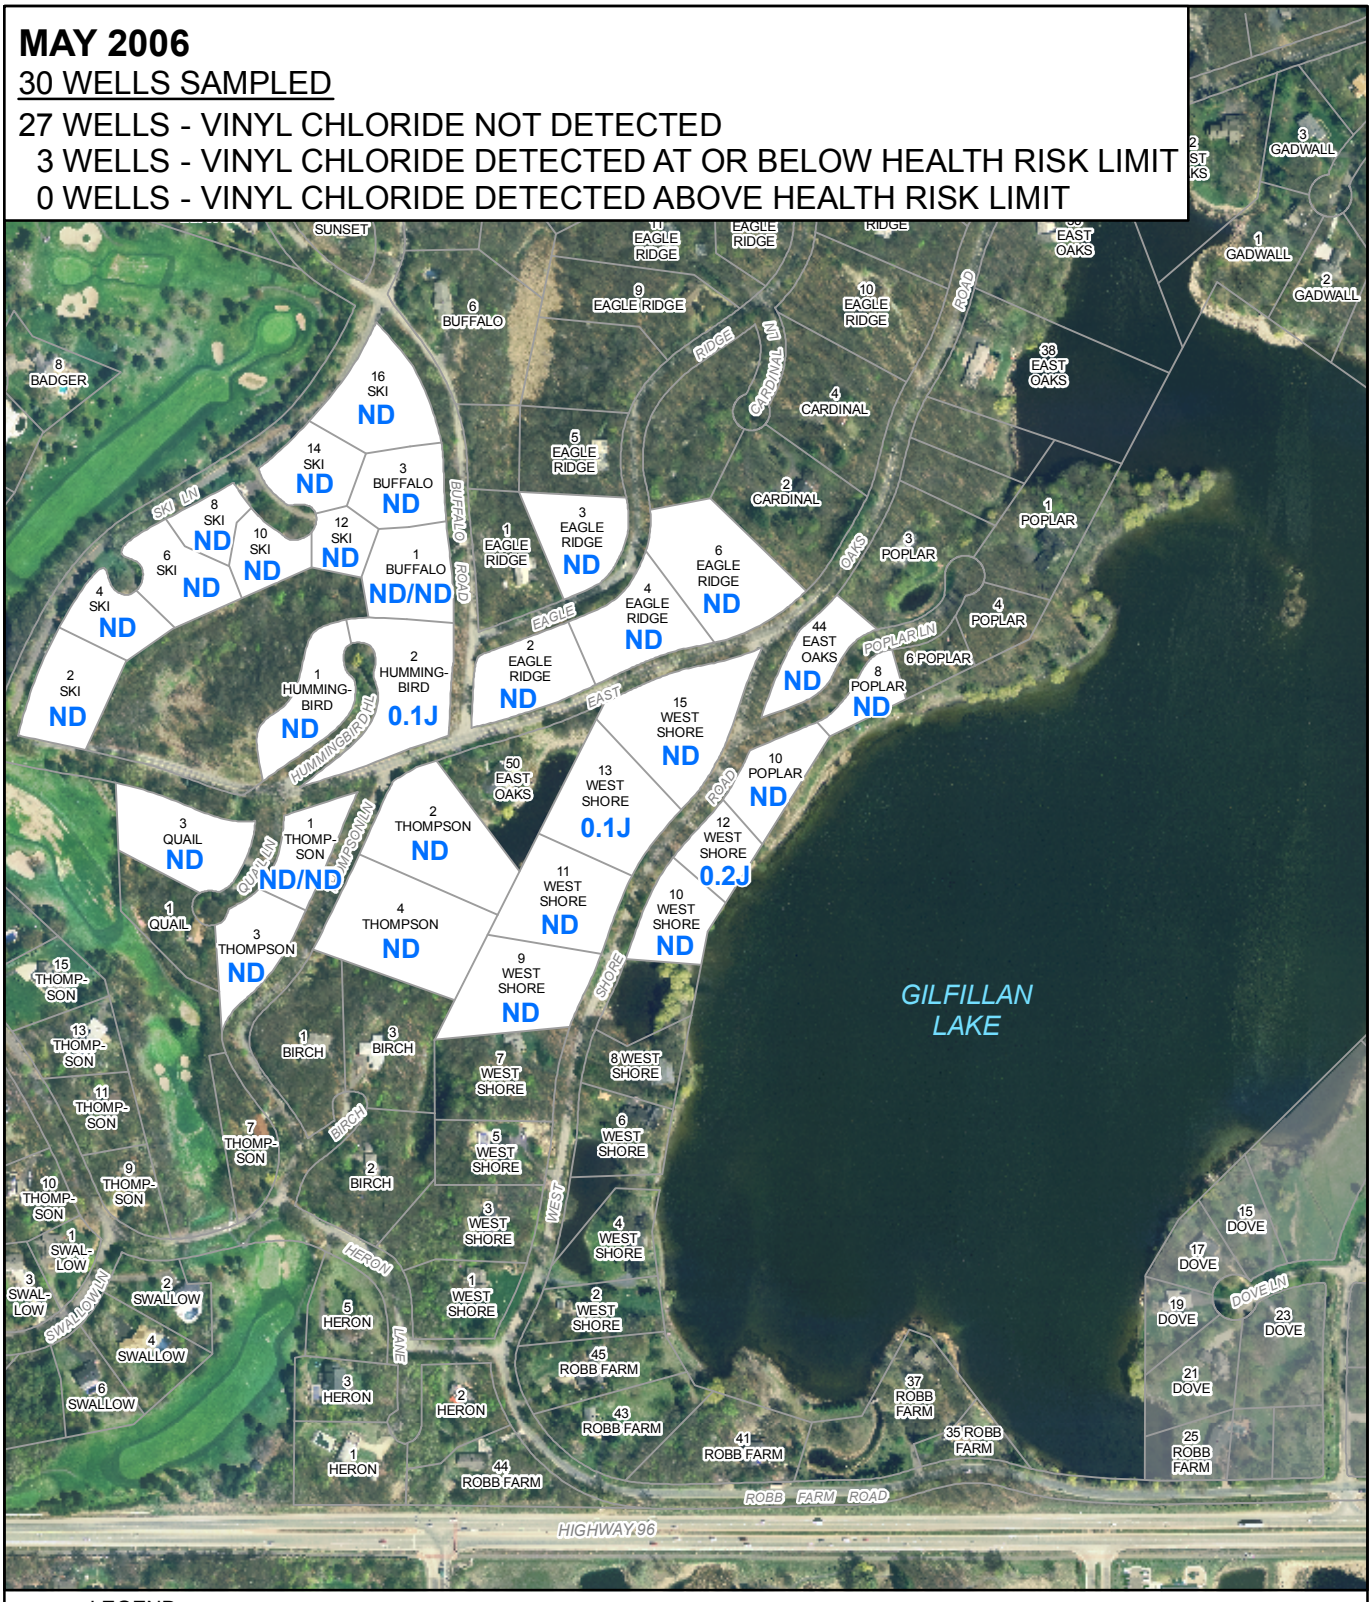

LEGEND

ND	VINYL CHLORIDE NOT DETECTED (DETECTION LIMIT = 0.10 µg/L)
ND/ND	DUPLICATE SAMPLE RESULT
0.1	VINYL CHLORIDE CONCENTRATION (µg/L)
J	ESTIMATED RESULT
	CONNECTED TO MUNICIPAL WATER SUPPLY

N

0 250 500

Feet

VINYL CHLORIDE CONCENTRATIONS (MAY 2006)

North Oaks, MN

2012-00(MISC014)GIS-SP001 JUL 13/2006