


OCTOBER 2009

76 WELLS SAMPLED

74 WELLS - VINYL CHLORIDE NOT DETECTED

2 WELLS - VINYL CHLORIDE DETECTED AT OR BELOW HEALTH RISK LIMIT

0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT

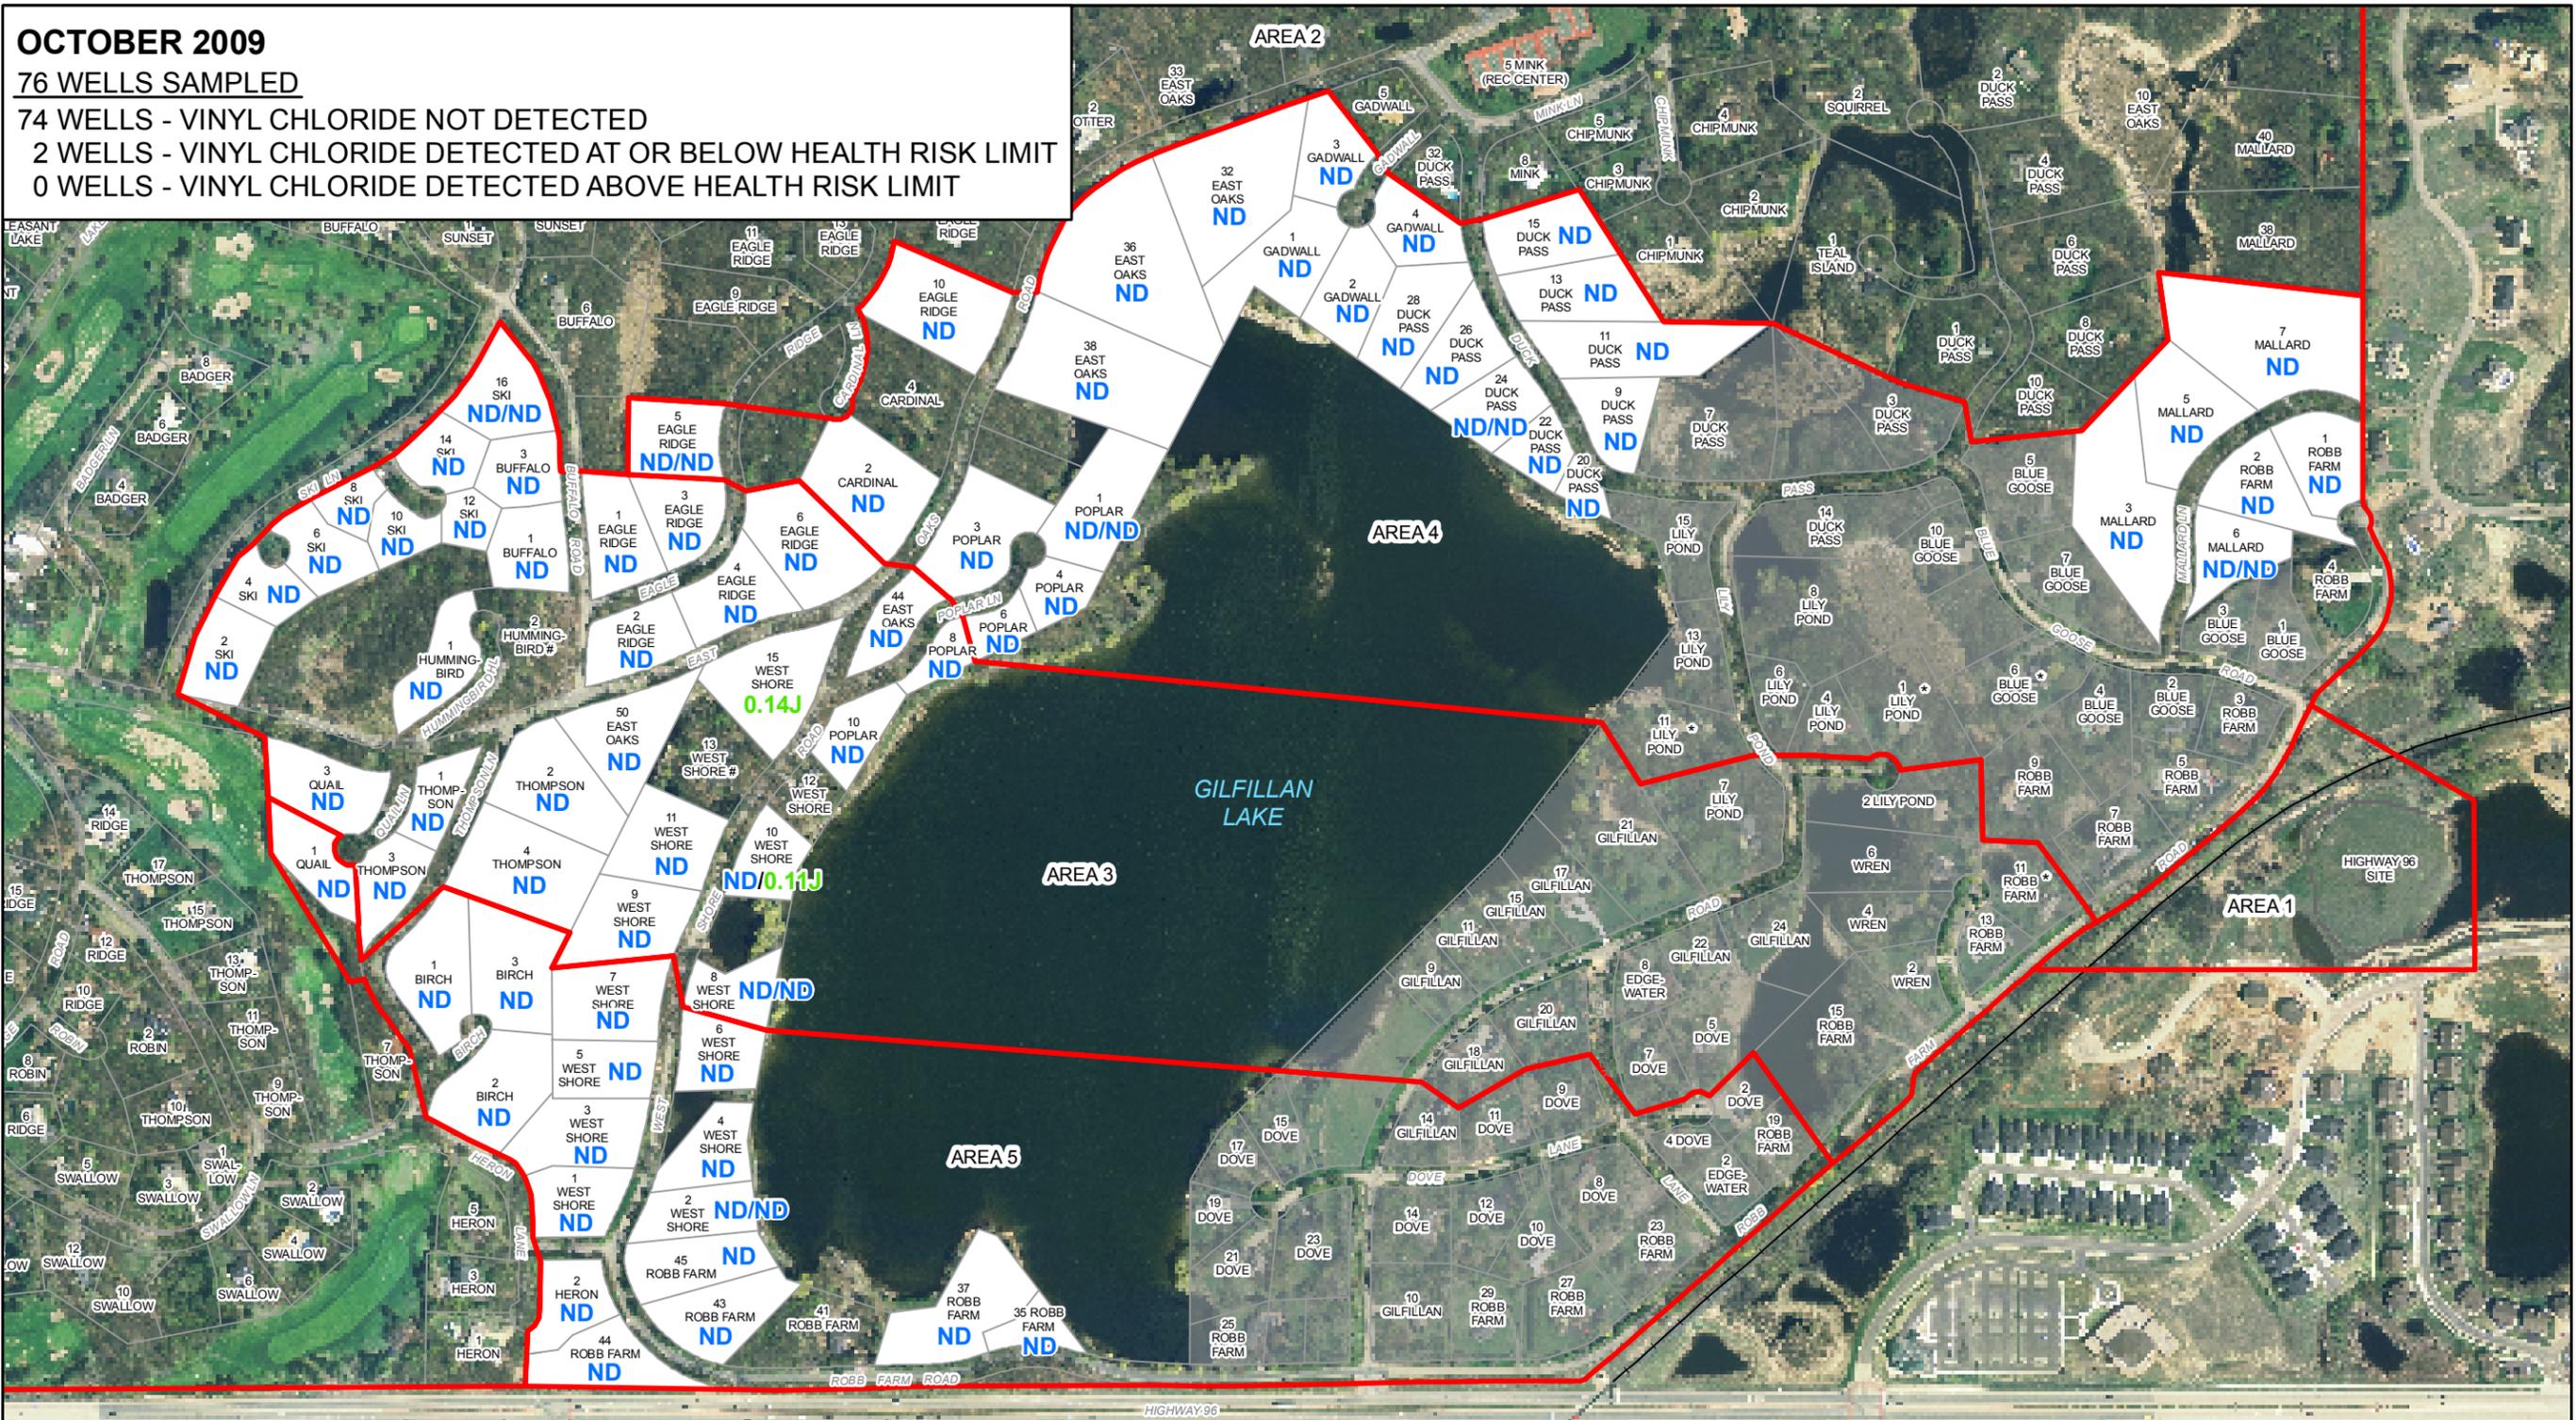

LEGEND

ND VINYL CHLORIDE NOT DETECTED
(DETECTION LIMIT = 0.10 µg/L)

ND/ND DUPLICATE SAMPLE RESULT

0.11 VINYL CHLORIDE CONCENTRATION (µg/L)

J ESTIMATED RESULT

CONNECTED TO MUNICIPAL WATER SUPPLY

GEOGRAPHIC AREAS

***** CONVERTED RESIDENTIAL MONITORING WELL LOCATION

NEW (DEEPER) REPLACEMENT WELL INSTALLED (MARCH 2009)




figure 1

VINYL CHLORIDE CONCENTRATIONS
(OCTOBER 2009)
North Oaks, Minnesota