FEBRUARY 2006

26 WELLS SAMPLED

25 WELLS - VINYL CHLORIDE NOT DETECTED

1 WELL - VINYL CHLORIDE DETECTED BELOW HEALTH RISK LIMIT

0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT

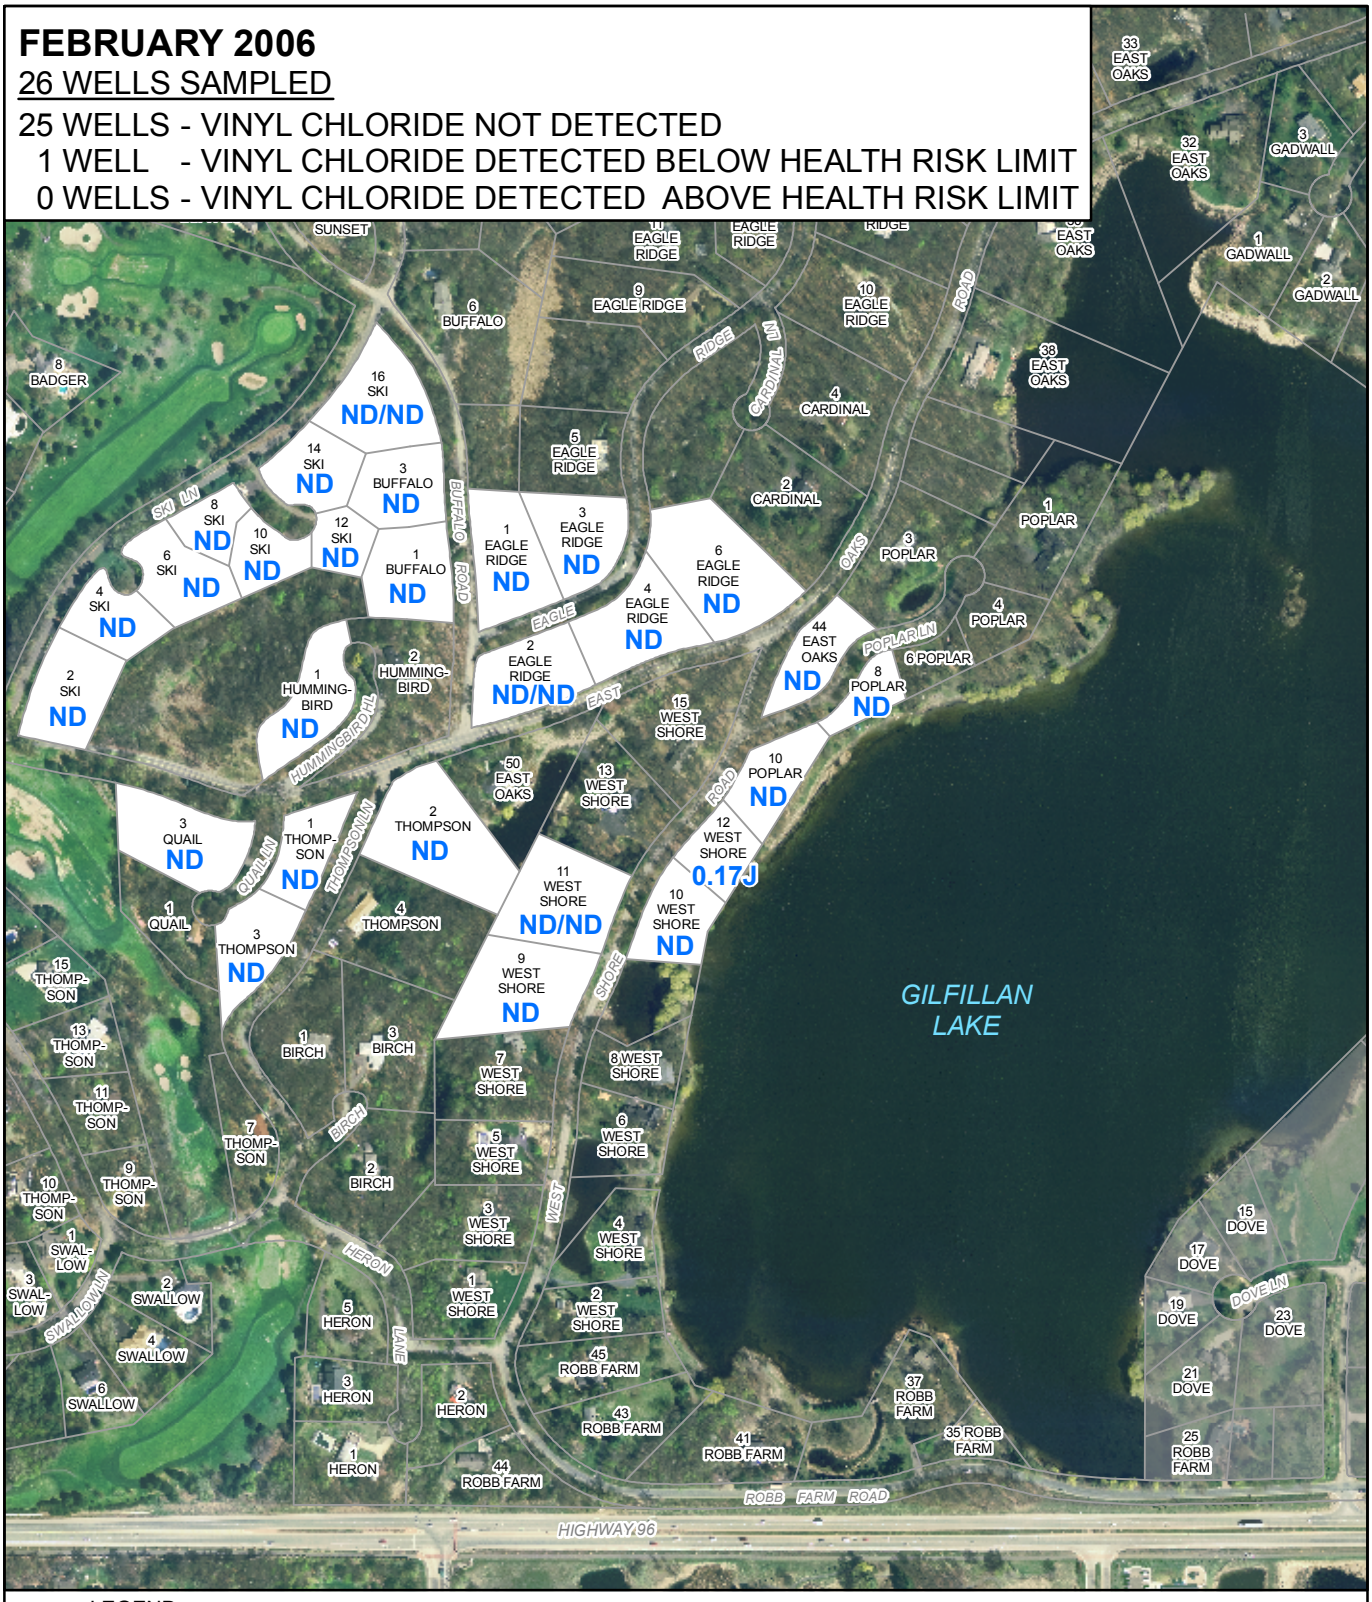

LEGEND

ND	VINYL CHLORIDE NOT DETECTED (DETECTION LIMIT = 0.10 µg/L)
ND/ND	DUPLICATE SAMPLE RESULT
0.17	VINYL CHLORIDE CONCENTRATION (µg/L)
J	ESTIMATED RESULT
	CONNECTED TO MUNICIPAL WATER SUPPLY

N

0 250 500

Feet

VINYL CHLORIDE CONCENTRATIONS (FEBRUARY 2006)

North Oaks, MN

2012-00(MISC012)GIS-SP001 APR 6/2006