OCTOBER 2007

75 WELLS SAMPLED

73 WELLS - VINYL CHLORIDE NOT DETECTED

2 WELLS - VINYL CHLORIDE DETECTED AT OR BELOW HEALTH RISK LIMIT

0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT

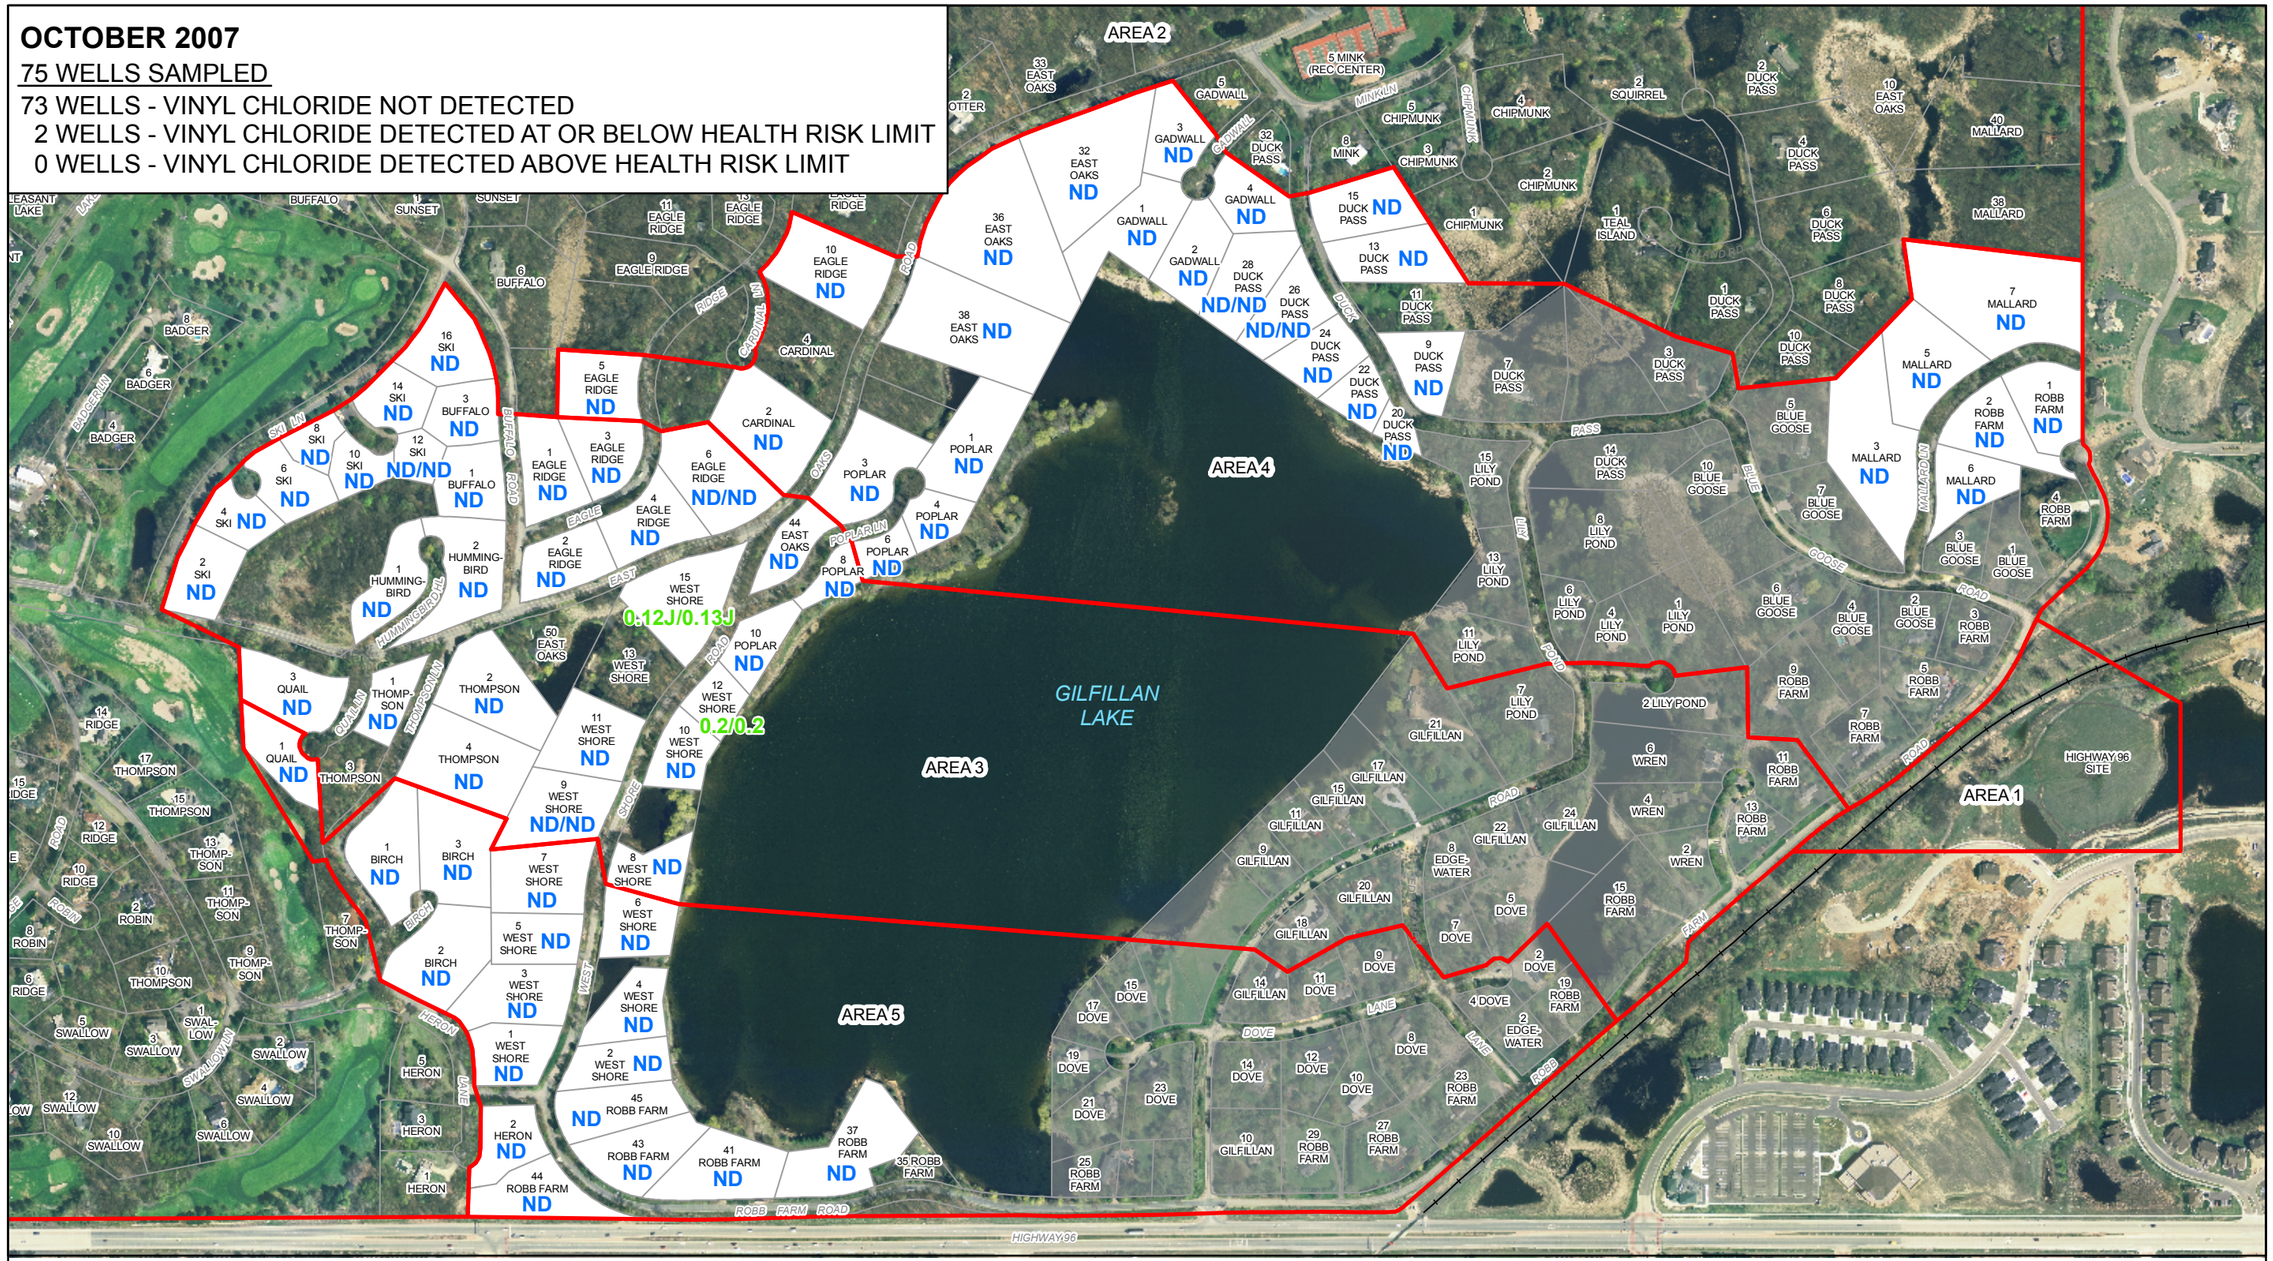

LEGEND

ND	VINYL CHLORIDE NOT DETECTED (DETECTION LIMIT = 0.10 µg/L)
ND/ND	DUPLICATE SAMPLE RESULT
0.1	VINYL CHLORIDE CONCENTRATION (µg/L)
J	ESTIMATED RESULT

CONNECTED TO MUNICIPAL WATER SUPPLY

GEOGRAPHIC AREAS

N

0 250 500

Feet

VINYL CHLORIDE CONCENTRATIONS (OCTOBER 2007)

North Oaks, Minnesota

2012-00(MISC022)GIS-SP001 DEC 10/2007