


**APRIL 2009**

**30 WELLS SAMPLED**

**28 WELLS - VINYL CHLORIDE NOT DETECTED**

**2 WELLS - VINYL CHLORIDE DETECTED AT OR BELOW HEALTH RISK LIMIT**

**0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT**

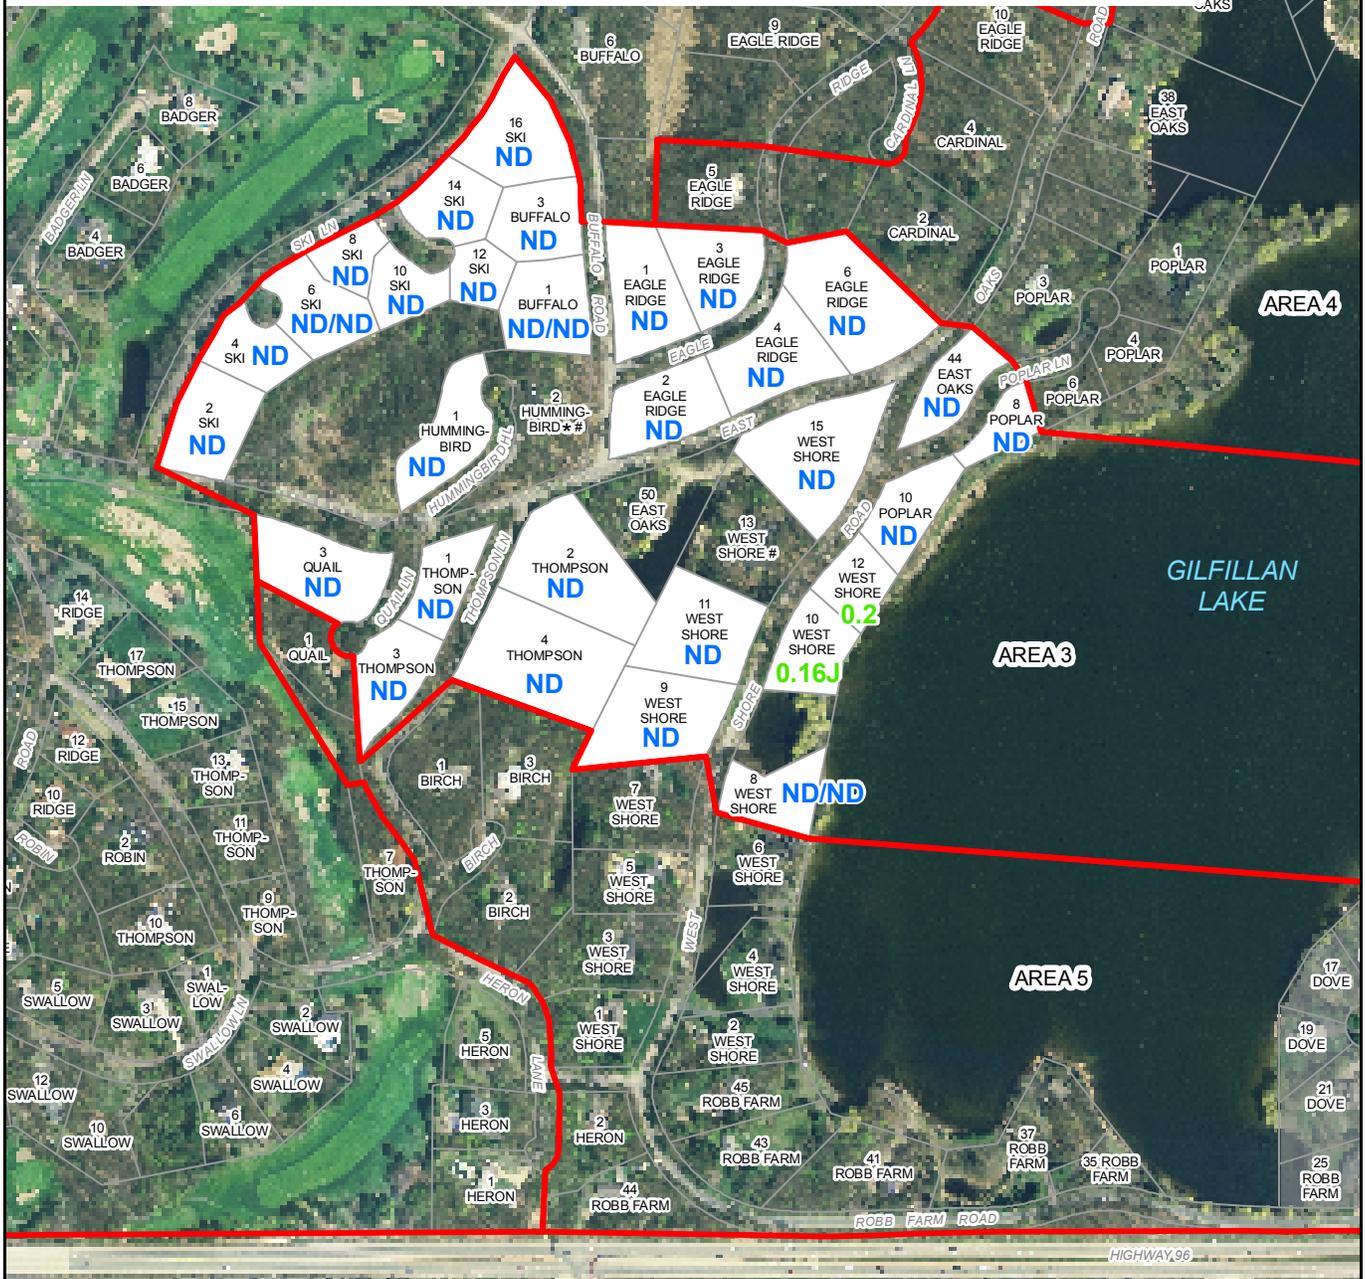

**LEGEND**

- 0.16** VINYL CHLORIDE CONCENTRATION (µG/L)
- J** ESTIMATED RESULT
- ND** VINYL CHLORIDE NOT DETECTED (DETECTION LIMIT = 0.10 µG/L)
- ND/ND** DUPLICATE SAMPLE RESULT
- \*** CONVERTED RESIDENTIAL MONITORING WELL LOCATION
- #** NEW (DEEPER) REPLACEMENT WELL INSTALLED (MARCH 2009)
- CONNECTED TO MUNICIPAL WATER SUPPLY
- GEOGRAPHIC AREAS




figure 1

**VINYL CHLORIDE CONCENTRATIONS (APRIL 2009)**  
**North Oaks, Minnesota**