


**OCTOBER 2016**

**56 WELLS SAMPLED**

**56 WELLS - VINYL CHLORIDE NOT DETECTED**

**0 WELLS - VINYL CHLORIDE DETECTED AT OR BELOW HEALTH RISK LIMIT**

**0 WELLS - VINYL CHLORIDE DETECTED ABOVE HEALTH RISK LIMIT (0.2 µg/L)**

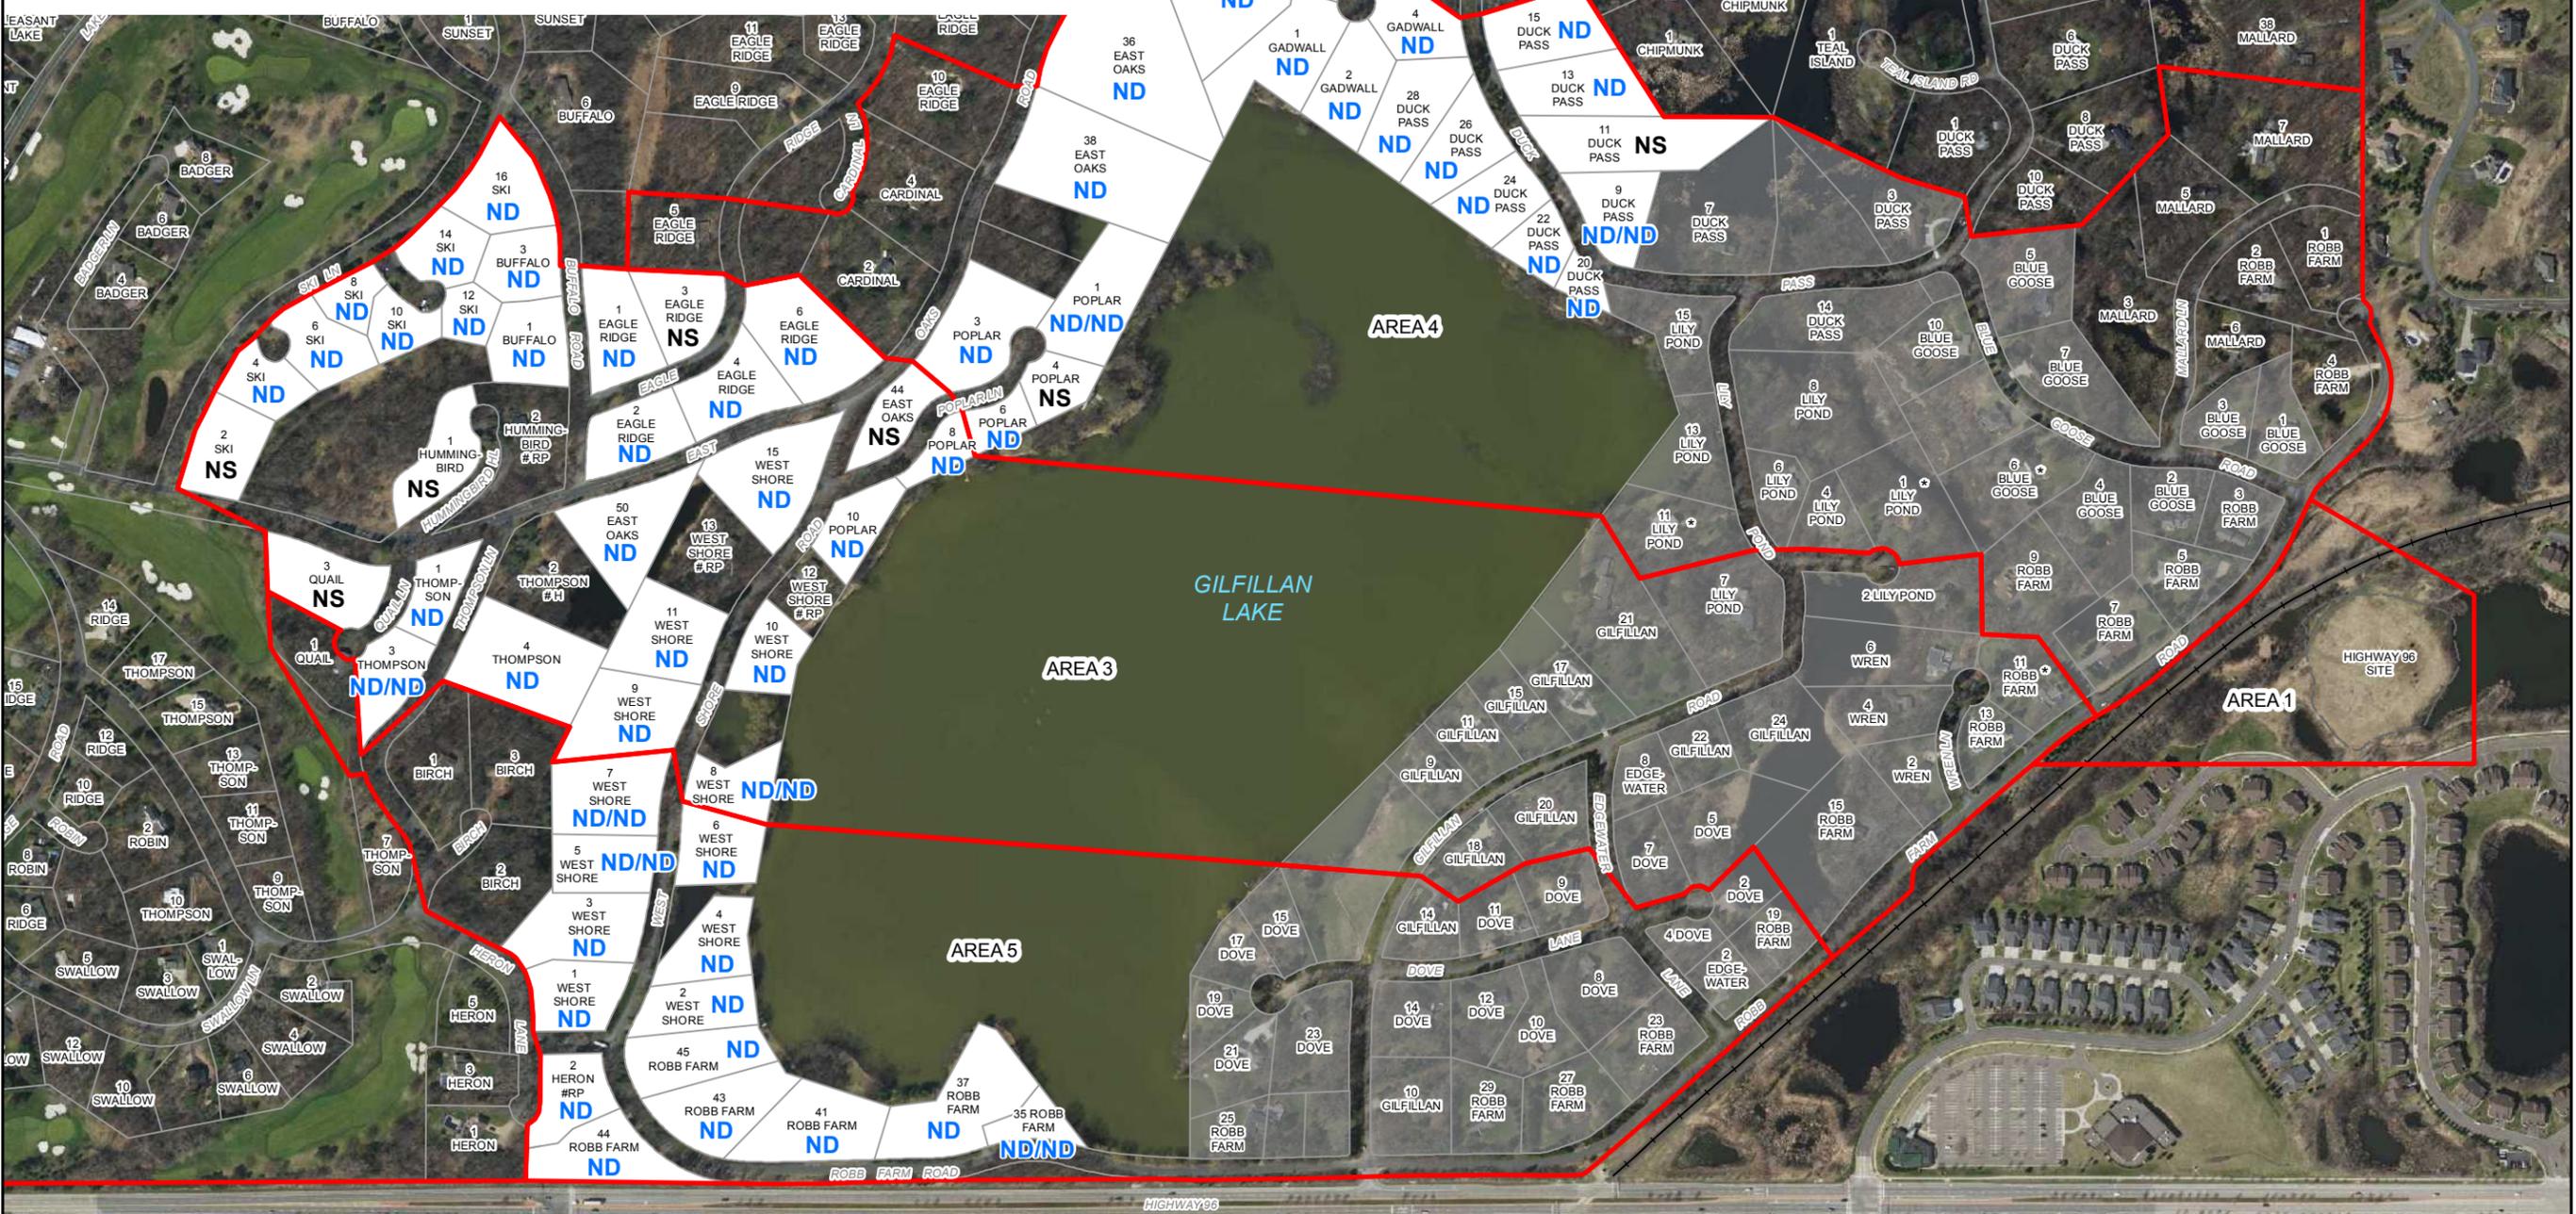

**LEGEND**

**ND** VINYL CHLORIDE NOT DETECTED  
(DETECTION LIMIT = 0.059 µg/L)

**ND/ND** DUPLICATE SAMPLE RESULT

**NS** NOT SAMPLED  
(NO RESPONSE/DECLINED/WATER OFF)

 CONNECTED TO MUNICIPAL  
WATER SUPPLY

**#RP** NEW (DEEPER) REPLACEMENT WELL  
INSTALLED BY RPs

**#H** NEW (DEEPER) REPLACEMENT WELL  
INSTALLED BY HOMEOWNER

**\*** CONVERTED RESIDENTIAL MONITORING  
WELL LOCATION

 GEOGRAPHIC AREAS




figure 1

VINYL CHLORIDE CONCENTRATIONS  
(OCTOBER 2016)  
North Oaks, Minnesota